

## WALL SECTION NOTES

1. FINISH GRADE. SLOPE AWAY FROM BLDG 1/8" PER FT FOR 4 FT. HORIZONTAL MIN. - SEE CIVIL AND L.S. DWGS FOR MORE DETAIL - ALSO SEE CD-11 FOR AVG. GRADE 2. EXPANSION JOINT/ BOND BREAKER, 1/2" TYPICAL, 1" AT SELECT LOCATIONS. 2" EMSEAL EXPANSION JOINT @ PARKING DECK

3. TYPICAL CONC. S.O.G.: REINF. CONC. OVER CONT. VAPOR BARRIER (SEE STRUCTURAL FOR THICKNESS) ON 4" GRAVEL ON GRADE (COMPACTED AND TERMITE-TREATED) ON RIGID INSULATION @ PERIMETER OF BUILDING ENVELOPE. 4. <u>CONCRETE VAPOR BARRIER</u> - (2) LAYERS 6MIL POLY. MEMBRANE OVERLAP & TAPE JOINTS 12" MIN. AND SEAL VERTICAL PENETRATIONS PRIOR TO PLACEMENT

OF CONCRETE. 5. TYPICAL WALL BASE PLATE ASSEMBLY (WHERE ATOP FOUNDATIONS): P.T. OR F.R.T. WOOD SILL PLATE (TYPE & SIZE PER STRUCTURAL) WITH CONT. SEAL GASKET AND CONT. BEAD OF SEALANT, BOTTOM SIDE. ANCHOR PER STRUCTURAL

SPECIFICATIONS FOR VARIOUS SHEAR WALL TYPES, TYP. 6. <u>TYPICAL THRU-WALL FLASHING AT BASE OF MASONRY VENEER.</u> WEEPS AT 24" O.C. HORIZ. OVER FLASHING. MORTAR NET CONTINUOUS OVER FLASHING. NO VNER. ANCHORS WITHIN 12" VERT. OF FLASHING. GROUT FILL SOLID CONTINUOUS BELOW

7. WOOD FRAMED EXTERIOR WALL ASSEMBLY PER LOCATION AS FOLLOWS:
A. CONSTRUCTION TYPE IIIA (BLDGS 1000, 2000, 3000 & 4000)/ LOAD BEARING

CONDITIONS- 2 HOUR, UL U371 ASSEMBLY (FIRE RETARDANT TREATED WOOD B. CONSTRUCTION TYPE IIIA (BLDGS 1000, 2000, 3000 & 4000)/ NON-LOAD BEARING CONDITIONS - NON-RATED ASSEMBLY (FIRE RETARDANT TREATED WOOD

8. 4MM METAL PANELS IN METALLIC FINISH WITH REVEAL SYSTEM. COLOR TBD.

9. <u>TYPICAL BRICK VENEER</u>
MODULAR SIZE BRICK WITH GALVANIZED ADJUSTABLE MASONRY ANCHORS AT 16" O.C. VERTICAL AND HORIZONTAL, OVER AIR SPACE AND CONTINUOUS 60 MIL FLEXIBLE MEMBRANE THROUGH WALL FLASHING AND CELL VENTS WITH PLASTIC WEEP TUBES @ 24" O.C. WITH ROPE WICKS. LAP AIR AND MOISTURE BARRIER OVER FLASHING & TAPE. GROUT FILL CAVITY BELOW LOWEST LEVEL OF FLASHING.

10. FIBER CEMENT PANEL WITH REVEAL SYSTEM OVER AIR/ MOISTURE BARRIER (EXTERIOR SIDE). 11. TYPICAL TENANT SEPARATION WALL ASSEMBLY (1-HOUR RATED, UL #U341, MIN.

EACH SIDE. SEE STRUCTURAL FOR STUD SPACING. 12. TYPICAL STAIR SHAFT WALL ASSEMBLY (WOOD) (2-HOUR-RATED) UL# U336. MIN. 50 S.T.C.

13. TYPICAL STAIR SHAFT WALL ASSEMBLY (CMU) (2-HOUR RATED)

14. TYPICAL UNIT FLOOR/CEILING ASSEMBLY (1-HOUR RATED, UL #L521, SYSTEM #4. MIN. 50 S.T.C. & IIC):

1" GYPCRETE ON ENKANSONIC SOUND CONTROL MAT, OVER FLOOR SHEATHING ON 18" PARALLEL CHORD TRUSS (SEE UNIT FRAMING PLAN). CEILING TO BE RESILIENT CHANNELS RAN PERPENDICULAR TO FLOOR TRUSS AND ONE (1) LAYER 5/8" TYPE "C" GYPSUM BOARD. PROVIDE R-11 SOUND BATT INSULATION AT CAVITY

15. <u>TYPICAL CORRIDOR FLOOR/CEILING ASSEMBLY</u> (UL # L528, 1 HOUR) 1 1/2" LIGHTWEIGHT CONCRETE ON 15# FELT OVER 3/4" FLOOR SHEATHING (SEE FLOOR PLANS FOR CHANGE OF MATERIAL AT WEATHER EXPOSED CONDITIONS) ON PREMANUFACTURED WOOD TRUSSES (SEE STRUCTURAL DRAWINGS), OVER RESILIENT CHANNELS WITH 1 LAYER 5/8" FIRE-RATED, TYPE 'C' WATER-RESISTANT EXTERIOR GYPSUM BOARD CEILING.

16. TYPICAL BALCONY FLOOR/ CEILING ASSEMBLY (NON-RATED DUE TO SPRINKLER HEAD AT EACH BALCONY TYP). MIN 1-1/2" LIGHTWEIGHT CONC. BROOM FINISH OVER 60 MIL. POLY. MBR. ON 3/4" PT T&G PLYWOOD SUBFLOOR OVER PT WOOD FLOOR FRAMING (SEE STRUCTURAL UNIT FRAMING PLANS). CEILING TO BE PAINTED 5/8" TYPE "C" EXT. GYPSUM BOARD.

17. TYPICAL LOW-SLOPE ROOF/ CEILING ASSEMBLY (UL# P522): THERMOPLASTIC POLYOLEFIN (T.P.O.) ROOFING SYSTEM OVER 3/4" T&G PLYWOOD ROOF DECK ON WOOD ROOF TRUSSES (TOP SIDE)/ (1) LAYER OF 5/8" TYPE "C" GYPSUM BOARD ON RESILIENT CHANNELS RUN PERPENDICULAR TO PREMANUFACTURED WOOD TRUSSES (BOTTOM SIDE). PROVIDE MIN. R-38 BATT INSULATION ABOVE / ON

18. <u>TYPICAL FIRE RESISTANT ROOF DECK ASSEMBLY</u>: 5/8' TYPE "X" GYPSUM BOARD ON 2" X 2" LEDGERS MIN. 4'-0" HORIZONTAL FROM ADJACENT FIREWALL (EACH SIDE OF FIREWALL, WHERE APPLICABLE). OPENINGS IN THE ROOF SHALL NOT BE LOCATED WITHIN THIS FIRE RESISTANT ROOF DECK ASSEMBLY). 19. PREFINISHED SINGLE-HUNG (OR FIXED) ALUMINUM FRAME WINDOW ASSEMBLY

WINDOW SCHEDULE. 20. TYPICAL 42" HIGH METAL GUARDRAIL ASSEMBLY, PAINTED OR STAINLESS STEEL 21. METAL COPING, PREFINISHED (PAINTED), OVER WATER AND ICE SHIELD ON

22. WEEP HOLES @ 24" O.C. OVER THRU-WALL FLASHING, ON STEEL LINTEL (@ WINDOWS AND DOORS ONLY). MORTAR NET CONTINUOUS OVER FLASHING. 23. FILTER FABRIC AROUND 18" X 18" GRAVEL SURROUNDING 6" DIAMETER

24. FOUNDATION WATER PROOFING SYSTEM.

25. SCHEDULED DOOR (SEE FLOOR PLANS & DOOR SCHEDULES).

26. FIBER-CEMENT BOARD/ TRIM. SEE DETAILS. 27. STEEL BEAM, SEE STRUCTURAL.

28. STEEL LINTEL ANGLE (PAINTED IF EXPOSED).

29. THERMALLY-BROKEN METAL STOREFRONT ASSEMBLY, PREFINISHED (PAINTED).

28. PRE-FINISHED ALUMINUM LOUVER W/ METAL CLOSURE PANEL TO MATCH FINISH.

29. SIMILAR TYPICAL (NON-RATED) BALCONY FLOOR/ CEILING ASSEMBLY. 30. CANTILEVER BEAM BEYOND (SHOWN HIDDEN). SEE STRUCTURAL.

31. BATT INSULATION (R-19)

32. 42" HIGH JULIET BALCONY RAIL SYSTEM.

33. 42" HIGH POWDER COATED ALUMINUM RAILING & POST

34. SCUPPER WITH COLLECTION BOX AND ALUMINUM DOWNSPOUT. 35. WALL MOUNTED HANDRAIL.

36. PREFINISHED ALUMINUM DRIP EDGE FLASHING. COLOR TO MATCH FASCIA.

37. PREFINISHED ALUMINUM CAP FLASHING. COLOR TO MATCH ADJACENT WALL. 38. BRICK SOLDIER COURSE

SOLID BRICK AT ENDS

40. 5/4 x 10 HARDIE TRIM FASCIA

42. PAINTED STEEL TIE ROD - SEE STRUCTURAL

43. PRECAST CONCRETE WALL OR SPANDREL PANEL.


44. MIN. 3" CONCRETE TOPPING ON PRECAST DOUBLE-TEES.


45. T.O.P. = TOP OF PARAPET 46. CAST STONE CAP

47. INSULATION BAFFLE WITH BLOCKING AS REQUIRED. MAINTAIN 2" MINIMUM CLEAR FOR ATTIC VENTILATION, IF REQUIRED.

48. PEDESTAL PAVER SYSTEM ON PROTECTION BOARD, WATERPROOF MEMBRANE & TAPERED INSULATION ON EXTERIOR GRADE PLYWOOD ON WOOD TRUSSES 49. FLASHING THROUGH THE WALL



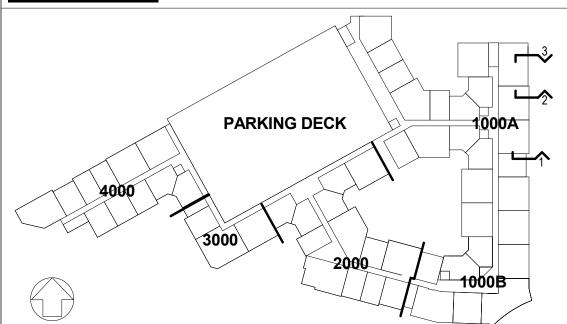

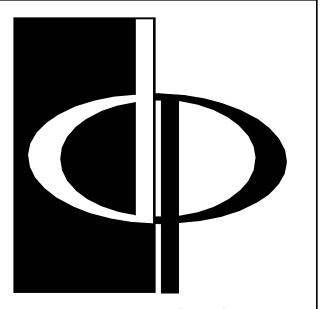

PARTNERSHIP, LLC A MULTI-DISCIPLINARY DESIGN FIRM

SOUTH TERRACES 115 PERIMETER CENTER PLACE, SUITE 950 ATLANTA, GEORGIA 30346 TELEPHONE: 770 396 7248 FAX: 770 396 2945

WWW.THEPRESTONPARTNERSHIP.COM CONSULTANT



RESERVE AT THE BALLPARK, PHASE II, AKA REVEL AT THE BALLPARK 2885 CRESCENT PKWY SMYRNA, GA 30080



ATLANTIC REALTY **PARTNERS** 

3438 PEACHTREE ROAD **SUITE 1425** ATLANTA, GA 30326

ISSUES & # - REVISIONS \_\_\_\_ CONCEPTUAL DESIGN SCHEMATIC DESIGN 09/28/2015 GMP/DESIGN DEVELOPMENT 10/15/2015 04/03/2017 PERMIT SET 05/22/2017 3 BUILDING PERMIT 07/25/2017

05/22/2017 1493101

EXTERIOR WALL SECTIONS

A5-12

**BUILDING PERMIT RE-SUBMISSION** © 2017 The Preston Partnership, LL0