UNITS SHOWN HERE, TO AVOID CONFLICT WITH 10'-0" CLEARANCE REQUIREMENT FROM CORRIDOR OUTDOOR AIR INTAKE.

5. APARTMENT UNIT WINDOWS OPEN SO THAT THE TOP OF OPENING IS AT 5'-0" A.F.F. EXHAUST TERMINATIONS ARE LOCATED ABOVE THE CEILING OF APARTMENTS WHICH IS LOCATED AT 9'-0" A.F.F. THIS CREATES A MINIMUM 4'-0" CLEAR FROM BUILDING OPENING TO A VENT CAP.

KEY NOTES:


TOILET EXHAUST OUTLET.
 DRYER EXHAUST VENT OUTLET.

3 O.A. INTAKE INLET. MAINTAIN 10'-0" FROM ANY EXHAUST OUTLET AS SHOWN ON THESE PLANS.

FEC NOTE: SEE SP-01 FOR GRADING __COORDINATION AND RETAINING WALL INFORMATION

BUILDING 4000 PROJECT LEVEL 2

SCALE: 1/8" = 1'-0"

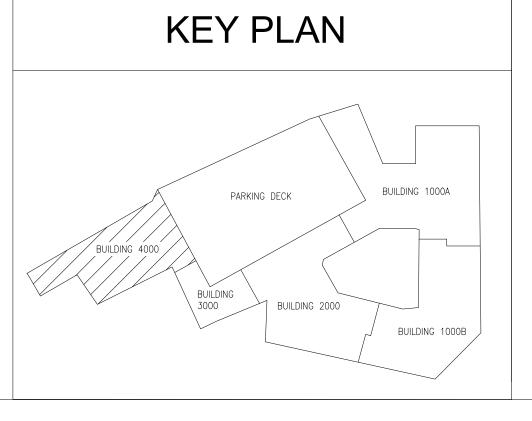




THE PRESTON
PARTNERSHIP, LLC
A MULTI-DISCIPLINARY DESIGN FIRM

SOUTH TERRACES

115 PERIMETER CENTER PLACE, SUITE 950
ATLANTA, GEORGIA 30346
TELEPHONE: 770 396 7248
FAX: 770 396 2945

WWW.THEPRESTONPARTNERSHIP.COM

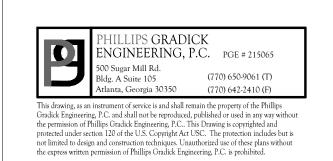



PROJECT

REVEL AT THE BALLPARK PHASE II 2885 CRESCENT PKWY SMYRNA, GA 30080



ATLANTIC REALTY PARTNERS

3438 PEACHTREE ROAD SUITE 1425 ATLANTA, GA 30326

 CONCEPTUAL DESIGN
 8/21/15

 SD PROGRESS SET
 09/28/15

 GMP PRICING SET
 10/14/15

 FOUNDATION PACKAGE
 12/07/15

 GMP PACKAGE
 04/03/17

 PERMIT SET
 05/22/17

DATE 05/22/2017

JOB NUMBER 1493101

DRAWN BY LD

CHECKED BY CMG

SHEET TITLE

BUIL DING 4000 PROJECT -

BUILDING 4000 PROJECT - LEVEL 2

M1-42

30X42 © 2017 The Preston Partnership, LLC