


**THE PRESTON  
PARTNERSHIP, LLC**  
A MULTI-DISCIPLINARY DESIGN FIRM

SOUTH TERRACES  
115 PERIMETER CENTER PLACE, SUITE 950  
ATLANTA, GEORGIA 30346  
TELEPHONE: 770 396 7248  
FAX: 770 396 2945

WWW.THEPRESTONPARTNERSHIP.COM  
CONSULTANT

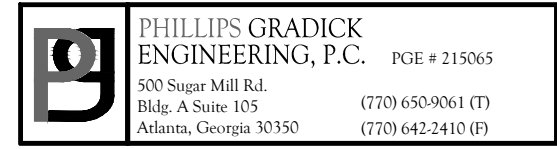

PHILLIPS GRADICK  
ENGINEERING, P.C. PCL# = 215065  
580 Super Mile Rd.  
Atlanta, Georgia 30308 (770) 650-9001 (F)  
(770) 650-2410 (R)

This drawing is the property of Phillips Gradick Engineering, P.C. and shall not be reproduced, published or used in any way without the written permission of Phillips Gradick Engineering, P.C. The drawing is prepared and printed under contract 123 of the U.S. Copyright Act 1976. The permission includes but is not limited to design and construction packages. Unauthorized use of these plans without the express written permission of Phillips Gradick Engineering, P.C. is prohibited.

SEAL



5/22/2017

PROJECT

**REVEL AT THE  
BALLPARK  
PHASE II**  
2885 CRESCENT PKWY  
SMYRNA, GA 30080

FOR



**ATLANTIC REALTY  
PARTNERS**

3438 PEACHTREE ROAD  
SUITE 1425  
ATLANTA, GA 30326

ISSUES & REVISIONS DATE

CONCEPTUAL DESIGN	8/21/15
50% PROGRESS SET	09/28/15
GMP PRICING SET	10/14/15
FOUNDATION PACKAGE	12/07/15
GMP PACKAGE	04/03/17
PERMIT SET	05/22/17

DATE 05/22/2017

JOB NUMBER 1493101

DRAWN BY LD

CHECKED BY CMG

SHEET TITLE

**BUILDING 4000 PLAN -  
LEVEL 8**

SHEET NUMBER

**M1-48**

COMMENTS

30X42 © 2017 The Preston Partnership, LLC



- NOTES:**
1. SEE SHEET M3.XX FOR APARTMENT HVAC.
  2. UNLESS NOTED OTHERWISE, ALL CEILINGS ARE PART OF A RATED FLOOR/CEILING ASSEMBLY, AND REQUIRE A CEILING RADIATION DAMPER (CRD) AT EACH PENETRATION OF CEILING.
  3. FOR MECHANICAL SYSTEMS SERVING THE CORRIDORS, THE O.A. INTAKE LOUVER SHALL BE INSTALLED A MINIMUM OF 10'-0" FROM APARTMENT UNITS TOILET EXHAUST. ADJUST TERMINATION POINT OF EXHAUST DUCTS AS NECESSARY FOR EACH APARTMENT UNIT.
  4. ALTERNATE ROUTING OF DRYER AND TOILET EXHAUST DUCT IN APARTMENT UNITS SHOWN HERE, TO AVOID CONFLICT WITH 10'-0" CLEARANCE REQUIREMENT FROM CORRIDOR OUTDOOR AIR INTAKE.
  5. APARTMENT UNIT WINDOWS OPEN SO THAT THE TOP OF OPENING IS AT 5'-0" A.F.F. EXHAUST TERMINATIONS ARE LOCATED ABOVE THE CEILING OF APARTMENTS WHICH IS LOCATED AT 9'-0" A.F.F. THIS CREATES A MINIMUM 4'-0" CLEAR FROM BUILDING OPENING TO A VENT CAP.

- KEY NOTES:**
- ① TOILET EXHAUST OUTLET.
  - ② DRYER EXHAUST VENT OUTLET.
  - ③ O.A. INTAKE INLET, MAINTAIN 10'-0" FROM ANY EXHAUST OUTLET AS SHOWN ON THESE PLANS.

**1 BUILDING 4000 PROJECT LEVEL 8**  
SCALE: 1/8" = 1'-0"

**KEY PLAN**

