

3″∨**I**

3"VI 2"V

3"∨**I**

SHOWER

2**"**W

TUB/

SHOWER


2"W


ግ 3"W

TOP FLOOR


2**"**W

2**"**W

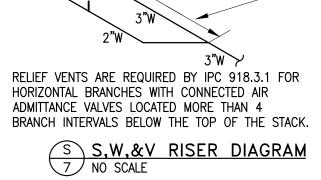


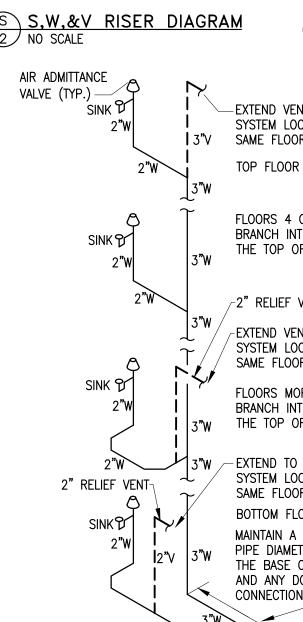

S S,W,&V RISER DIAGRAM

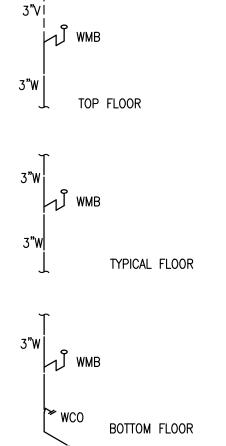

3"W

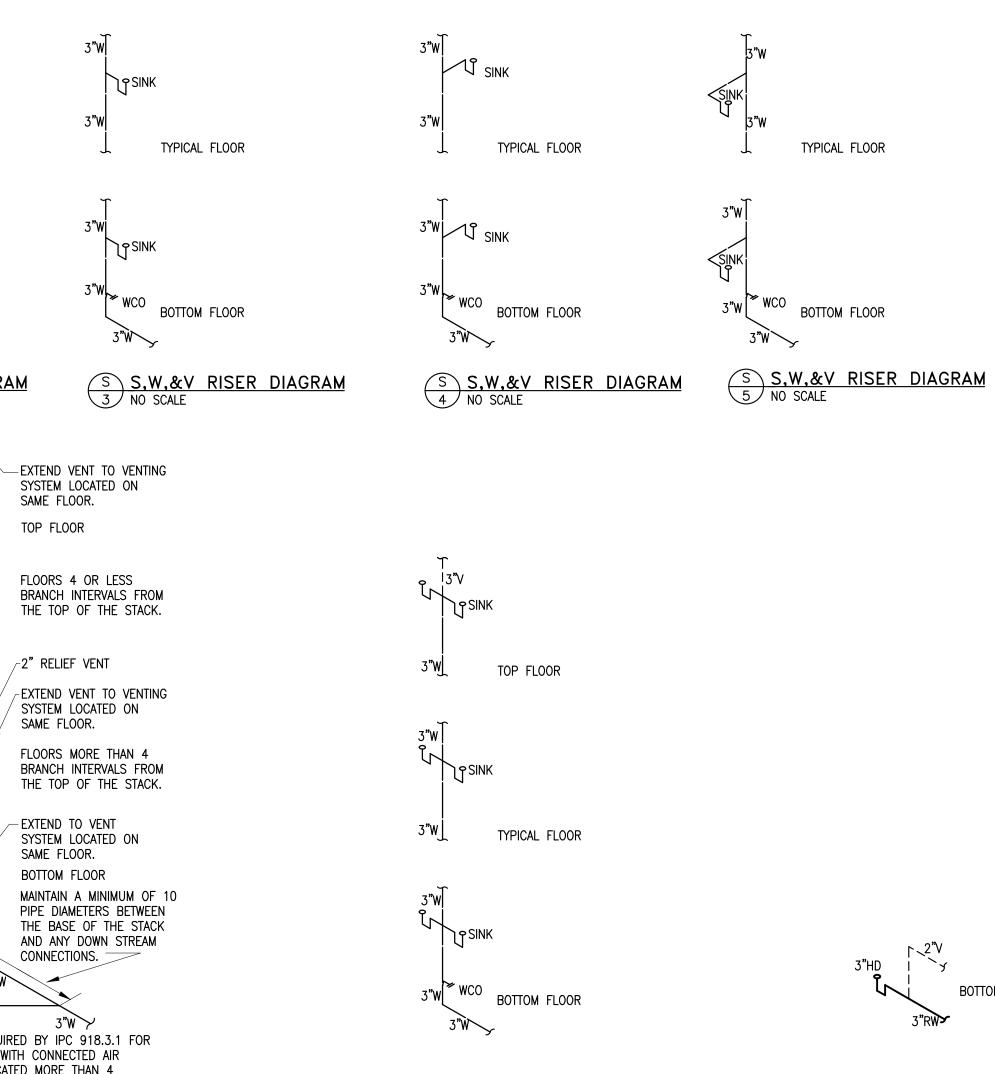

S S,W,&V RISER DIAGRAM 8 NO SCALE

3"V」 「「」」」SINK

TOP FLOOR

I3"∨

3"W


TOP FLOOR

3"V∣

TOP FLOOR

S S,W,&V RISER DIAGRAM 9 NO SCALE

BOTTOM FLOOR

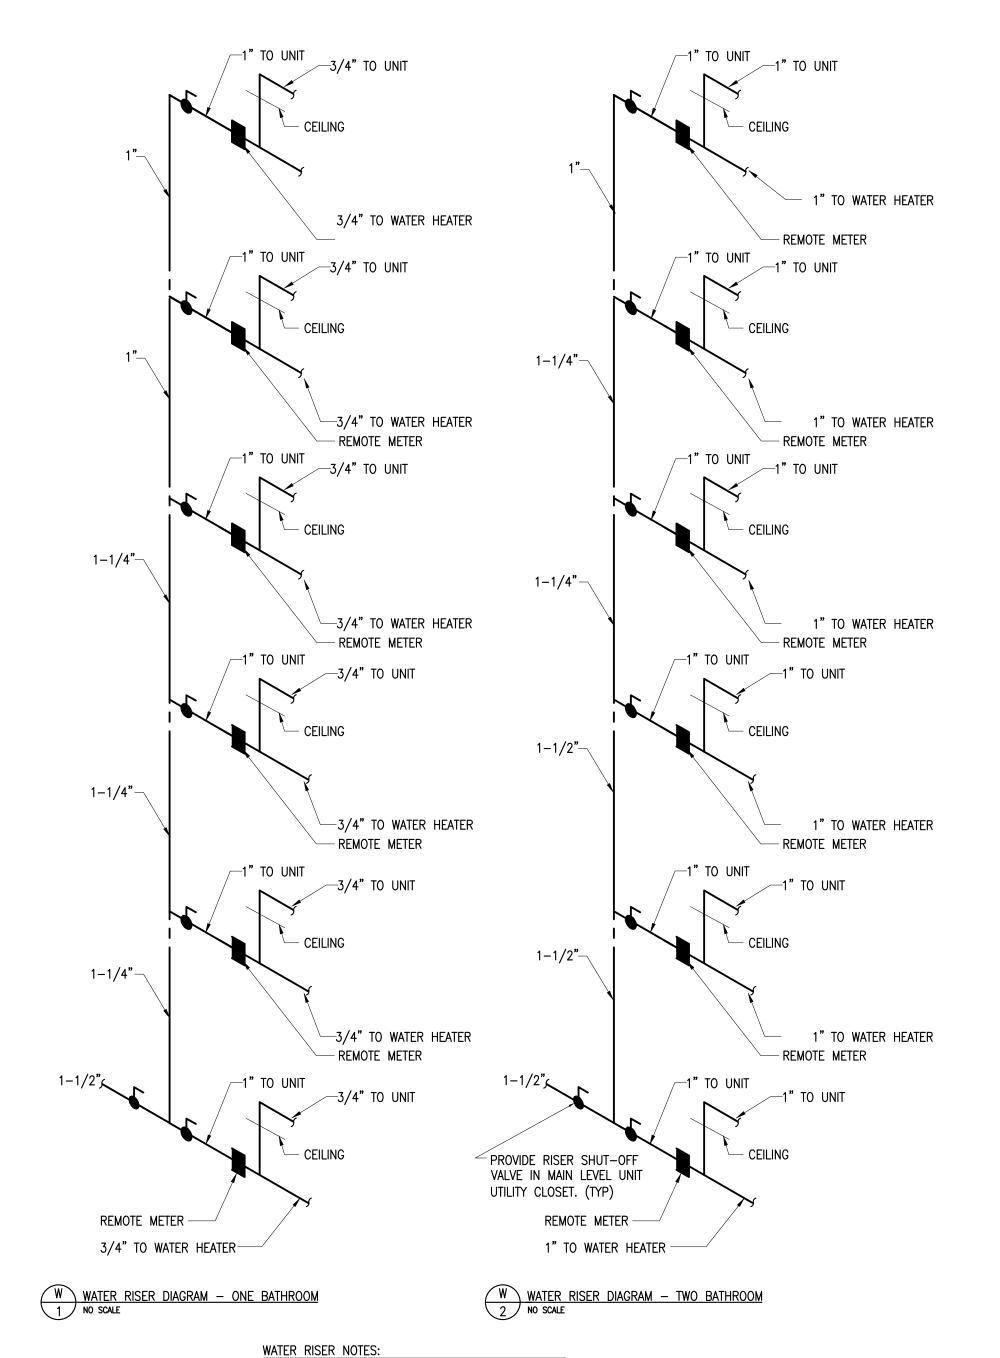

1. ALL PIPING ABOVE CEILING IN ATTIC TO BE

- LOCATED BELOW ATTIC INSULATION. 2. SOME RISERS HAVE RETAIL OR AMENITIES ON
- GROUND LEVEL INSTEAD OF THE BOTTOM LEVEL
- UNIT. SEE PLANS FOR LOCATIONS. 3. ALL PIPING DOWNSTREAM OF THE REMOTE METER SHALL BE CONTAINED IN THE APARTMENT UNIT IT SERVES – I.E. WATER PIPING SHALL NOT BE
- ROUTED IN THE FLOOR OF THE UNIT UNLESS REQUIRED FOR AN ISLAND SINK.

